Single pole and multipole thermal-magnetic miniature circuit breakers (MCBs) in accordance with EN 60947-2, UL 1077 and UL 489 for DIN rail mounting, with toggle actuation, visual status indication and high rupture capacity. A positively trip-free snap action mechanism ensures reliable switching behaviour. A range of trip characteristics and add-on modules allow a great variety of applications.

### **Typical applications**

Protection of cables, motors, generators and transformers, thyristors and silicon rectifiers. Protection of computers and their peripheral equipment, industrial process control systems, telecommunications equipment, power supplies.

### **Technical Data**

#### Voltage rating and current rating range

to IEC/EN 60947-2	1-pole: AC 240 V; 1 A63 A; 2, 3, 4-pole: AC 415 V, 1 A63 A; 1-pole: DC 80 V, 1 A63 A 2-pole: (2 poles connected in series) DC 125 V, 163 A 1-pole: AC 277 V; 1 A63 A; 2, 3, 4-pole: AC 480Y/277 V, 1 A63 A;
	1-pole: DC 60 V; 1 A63 A; 2-pole (2 poles connected in series): DC 125 V; 1 A63 A;
to UL 489	1-pole: AC 120 V; 1A63 A; 2, 3-pole: AC 240 V, 1 A63 A; 1-pole: AC 277 V; 1 A32 A; 2, 3-pole: AC 480Y/277 V; 1 A32 A; 1-pole: DC 60 V; 1 A63 A; 2-pole (2 poles connected in series); DC 125 V; 1 A63 A;
Typical life	

 Mechanically
 20,000 cycles

 Electrically
 6,000 cycles

### **Approvals**

Approval authority	Standard	Rated voltage	Current ratings
ΤÜV	IEC/EN 60947-2	AC 240/415 V DC 80 V DC 125 V	163 A 163 A (1-pole) 163 A (2 poles in series)
UL	UL 1077 / CSA-C22.2 No. 235	AC 480Y/277 V DC 60 V DC 125 V	163 A 163 A (1-pole) 163 A (2 poles in series)
UL	UL 489 / CSA-C22.2 No. 5	AC 240 V AC 480Y/277 V DC 60 V DC 125 V	163 A 132 A 163 A (1-pole) 163 A (2 poles in series)





UL 489 version

4230-T... IEC/EN60947-2 & UL1077 version

## **Technical Data**

Rupture capacity							
to IEC/EN 60947-2 (Ics) AC 7,500 A / DC 10,000 A							
to IEC/EN 609 (Icu)	. ,		10,000				
to UL 489		AC/DC	10,000	A			
to UL1077							
Number of poles	Un	In	TC	OL	SC		
1-pole	AC 240 V	163 A	1	1	7.5 kA, U1		
1-pole	AC 277 V	163 A	1	0	5 kA, U1		
2-, 3-, 4-pole	AC 480 V	163 A	1	1	5 kA, U1		
1-pole	DC 60 V	163 A	1	0	7.5 kA, U1		
2-pole in series	DC 125 V	163 A	1	0	7.5 kA, U1		
Insulation cod	ordination			tegory III ution de			
Degree of pro	otection	IP20	IP20				
Vibration (sinutest to IEC 60 test Fc		(57–500	± 0.38 mm (10–57 Hz), 5 g (57–500 Hz) 10 frequency cycles per axis				
Shock, test to IEC 60068-2-		30 g (1	30 g (11 ms)				
Corrosion, tes 60068-2-11, t		96 hrs i	96 hrs in 5% salt mist				
Humidity, test 60068-2-78, t			48 hours at 95% RH, temperature +40°C				
Terminals		screw t	screw terminals				
			Vertical connection possible by means of busbars				
Tightening to	rque	2 Nm n	nax.				
Stripping leng	gth	14 mm					
Cable cross s	≤35 mr	n²					
Ambient temp	oerature	-35°C	-35°C+ 70°C				
Mounting		rail mo	rail mounting				
Mass			7) appro		(EN 60947-2/ ) per pole		

and the second se
Mounting
T1 rail mounting
Number of poles
1 single pole protected
2 double pole protected
3 three pole protected
4 four pole protected*
Accessories
0 without
terminals
K0 screw terminals
Characteristic curve
B: thermal 1.05 - 1.30 x I <sub>N</sub> ; magnetic 3.2 - 4.8 x I <sub>N</sub>
C: thermal 1.05 - 1.30 x $I_N$ ; magnetic 6.4 - 9.6 x $I_N$
D: thermal 1.05 - 1.30 x I <sub>N</sub> ; magnetic 9.6 - 14.4 x I <sub>N</sub>
Approvals
E IEC/EN 60947-2 (TÜV) / UL 1077
U UL 489 (only 1-, 2- & 3-pole) /
IEC/EN 60947-2 (TÜV)
Current ratings:
1, 2, 3, 4, 5, 6, 7, 8, 10, 12, 13, 15, 16, 20, 25,
30, 32, 35, 40, 50, 60, 63 A

Order numbering code




No.

# 4230 - T1 1 0 - K0 C E - 10 A ordering example

\* not for UL 489


### **Schematic diagrams**

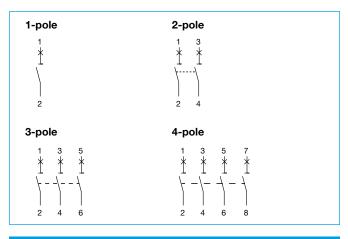


### **DC** application

When using the 4230-T in DC application, polarity does not have to be observed. Max. acceptable voltage between the conductors depends on the number of poles, circuitry and relevant standard / approval.


#### To IEC/EN 60947-2:




#### To UL 489 and UL 1077:



### Dimensions - IEC/EN 60947-2 / UL1077 version

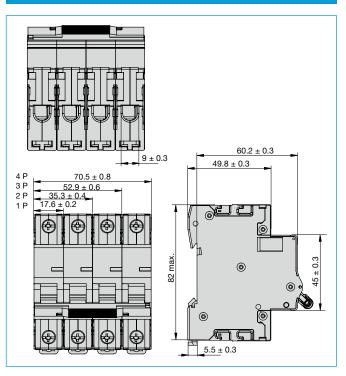


## **Dimensions – UL 489 version**

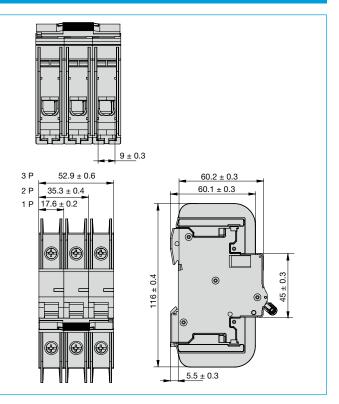

All dimensions without tolerances are for reference only. E-T-A reserves the right change specifications at any time in the interest of improved design, performance and cost effectiveness, the right to make changes in these specifications without notice is reserved. Product markings may not be exactly as the ordering codes. Errors and omissions excepted.

## **Time/current characteristics**

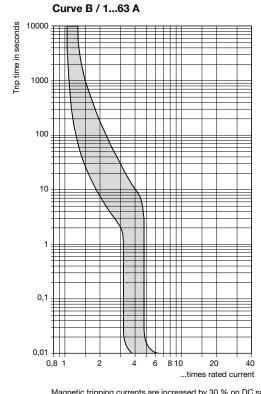

Magnetic tripping currents are increased by 30 % on DC supplies. Ambient temperature 30  $^\circ \text{C}$ 


Voltage drop in V at 1 I <sub>N</sub>									
I <sub>N</sub> (A)	1	1.2	1.5	1.6	2	3			
V	1.50	1.50	0.80	0.80	0.80	0.60			
I <sub>N</sub> (A)	4	5	6	7	8	10			
V	0.60	0.20	0.20	0.20	0.15	0.15			
I <sub>N</sub> (A)	12	13	15	16	20	25			
V	0.15	0.10	0.10	0.10	0.08	0.08			
I <sub>N</sub> (A)	30	32	35	40	50	60			
V	0.07	0.07	0.07	0.07	0.06	0.06			
I <sub>N</sub> (A)	63								
V	0.06								

# Current ratings and voltage drop @ +25°C


## Note

2312

When mounted side-by-side, the breakers can only carry up to 80 % of their rated current or a higher rating has to be selected (see chapter Technical Information).

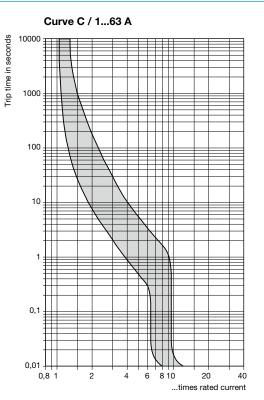

Magnetic tripping currents are increased by 30 % on DC supplies. Ambient temperature 30  $^\circ \rm C$ 

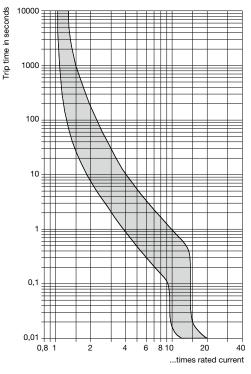

Curve D / 1...63 A

www.e-t-a.de

Magnetic tripping currents are increased by 30 % on DC supplies. Ambient temperature 30  $^\circ \rm C$ 

## Max. operating currents depending on ambient temperature

Max. operating currents depending on ambient temperature T

Rated cur- rent I <sub>N</sub> (A)	Max. operating currents depending on ambient temperature T (A)										
	-35°C	-30°C	-25°C	-20°C	-15°C	-10°C	-5°C	0°C	+5°C	+10°C	+15°C
1	1.27	1.25	1.23	1.21	1.19	1.17	1.15	1.13	1.10	1.08	1.06
2	2.87	2.81	2.74	2.68	2.62	2.55	2.48	2.42	2.35	2.28	2.20
3	3.89	3.83	3.76	3.70	3.64	3.57	3.50	3.44	3.37	3.30	3.22
4	4.91	4.83	4.76	4.70	4.64	4.57	4.50	4.44	4.37	4.30	4.22
5	6.68	6.56	6.44	6.32	6.19	6.07	5.94	5.81	5.68	5.54	5.40
6	7.70	7.58	7.46	7.34	7.21	7.09	6.96	6.83	6.70	6.56	6.42
7	8.78	8.66	8.54	8.42	8.29	8.17	8.04	7.91	7.78	7.64	7.50
8	9.80	9.68	9.56	9.44	9.31	9.19	9.06	8.93	9.80	8.66	8.52
10	13.89	13.62	13.35	13.07	12.81	12.53	12.23	11.93	11.63	11.33	11.01
12	15.91	15.64	15.37	15.09	14.83	14.55	14.25	13.95	13.65	13.35	13.03
13	16.92	16.65	16.38	16.10	15.84	15.56	15.26	14.96	14.66	14.36	14.04
15	19.77	19.42	19.07	18.74	18.39	18.04	17.69	17.32	16.95	16.57	16.19
16	20.78	20.43	20.08	19.75	19.40	19.05	18.70	18.33	17.96	17.58	17.20
20	25.67	25.28	24.88	24.47	24.06	23.64	23.22	22.78	22.34	21.89	21.43
25	32.21	31.72	31.22	30.70	30.18	29.65	29.10	28.55	27.98	27.41	26.82
30	39.00	38.42	37.78	37.13	36.47	35.80	35.11	34.43	33.71	32.99	32.26
32	41.04	40.46	39.82	39.17	38.51	37.84	37.15	36.47	35.75	35.03	34.30
35	44.08	43.50	42.86	42.21	41.55	40.88	40.19	39.51	38.79	38.07	37.34
40	51.63	50.86	50.04	49.21	48.37	47.51	46.63	45.74	44.83	43.90	42.95
50	64.92	63.97	62.92	61.86	60.77	59.67	58.54	57.40	56.23	55.05	53.81
60	80.45	79.03	77.61	76.16	74.69	73.19	71.67	70.11	68.51	66.88	65.21
63	83.48	82.06	80.71	79.19	77.72	76.22	74.70	73.14	71.54	69.91	68.24

rent I <sub>N</sub> (A)	(A)										
	+20°C	+25°C	+30°C	+35°C	+40°C	+45°C	+50°C	+55°C	+60°C	+65°C	+70°C
1	1.05	1.02	1.00	0.97	0.94	0.91	0.89	0.86	0.83	0.80	0.77
2	2.12	2.04	2.00	1.90	1.82	1.74	1.65	1.56	1.47	1.36	1.25
3	3.14	3.06	3.00	2.92	2.84	2.76	2.67	2.58	2.49	2.38	2.27
4	4.14	4.06	4.00	3.92	3.84	3.76	3.67	3.58	3.49	3.38	3.27
5	5.25	5.12	5.00	4.82	4.66	4.50	4.34	4.17	3.99	3.81	3.62
6	6.27	6.14	6.00	5.84	5.68	5.52	5.36	5.19	5.01	4.83	4.64
7	7.35	7.22	7.00	6.92	6.76	6.60	6.44	6.27	6.09	5.91	5.72
8	8.37	8.24	8.00	7.94	7.78	7.62	7.46	7.29	7.11	6.93	6.74
10	10.67	10.34	10.00	9.63	9.24	8.85	8.45	8.01	7.55	7.06	6.55
12	12.69	12.36	12.00	11.65	11.26	10.60	10.47	10.03	9.57	9.08	8.57
13	13.70	13.37	13.00	12.66	12.27	11.61	11.48	11.04	10.58	10.09	9.58
15	15.79	15.39	15.00	14.54	14.10	13.65	13.19	12.70	12.20	11.69	11.64
16	16.80	16.40	16.00	15.55	15.11	14.66	14.20	13.71	13.21	12.70	12.65
20	20.96	20.47	20.00	19.47	18.95	18.42	17.87	17.30	16.71	16.10	15.47
25	26.22	25.61	25.00	24.33	23.67	23.00	22.28	21.56	20.80	20.02	19.21
30	31.50	30.73	30.00	29.13	28.30	27.44	26.56	25.65	24.71	23.74	22.73
32	33.54	32.77	32.00	31.17	30.34	29.48	28.69	27.69	26.75	25.78	24.77
35	36.58	35.81	35.00	34.21	33.38	32.52	31.64	30.73	29.79	28.82	27.81
40	41.98	40.99	40.00	38.93	37.85	36.75	35.61	34.43	33.21	31.95	30.63
50	52.56	51.28	50.00	47.82	46.24	44.81	43.33	41.81	40.23	38.58	35.77
60	63.50	61.75	60.00	57.08	55.16	53.18	51.13	49.00	46.78	44.47	40.47
63	66.53	64.78	63.00	60.11	58.19	56.21	54.16	52.03	49.81	47.50	43.50

Rated cur-

Add-on module for circuit breaker type 4230-T. The auxiliary switch has a change-over contact as signal contact and is operated with actuation of the MCB.


### **Typical applications**

Status monitoring of MCB and/or the connected loads.

### Mounting

The add-on module is mounted on the left side of the MCB (seen from the front). For mounting, the MCB has to be in the OFF position.

### Order numbering code

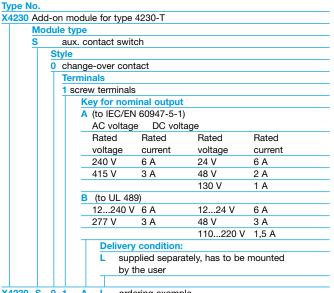

X4230- S 0 1 A L ordering example

#### **Technical Data**

#### Rated currents to IEC/EN 60947-5-1:

Voltage ratings:	AC 240 V	AC 415 V	DC 24 V	DC 48 V	DC 130 V
Current ratings:	6 A	3 A	6 A	2 A	1 A

#### Rated currents to UL 489:

Voltage ratings:	AC 12 240 V	AC 277 V	DC 12 24 V	DC 48 V	DC 110 220 V			
Current ratings:	6 A	3 A	6 A	3 A	1.5 A			
Typical life		20,000	20,000 cycles					
Tightening to	rque	1 Nm r	1 Nm max.					
Ambient tem	perature	-35 °C	-35 °C+ 70 °C					
Width		9 mm						
Mass		approx	approx. 29 g					

### Approvals

Approval authority	Standard	Types
ΤÜV	IEC/EN 60947-5-1	with key index "A"
UL	UL 489	with key index "B"

### **Mounting instructions**

#### Mounting to MCB to UL 489

The following steps have to be carried out for mounting the auxiliary contact module:

- Remove the left-side covers for the latching notches of the auxiliary contact module on both isolation pieces of the MCB, e.g. by means of a screw driver
- Pull off the isolation pieces from the MCB to the front
- Remove blanking plug on MCB to open left-side holes for latching notches of auxiliary switch
- Re-insert isolation pieces onto MCB
- Pull off left-side adhesive cover and carefully remove the perforated cover below


Caution: the MCB to UL489 must only be operated with the insulation pieces fitted.

## Schematic diagrams



Note: As soon as the auxiliary contact module is mounted on the MCB, the terminals 11 and 14 are connected when the MCB is in ON condition. Terminals 11 and 12 are connected when the MCB is in OFF condition.

### **Mounting principle**

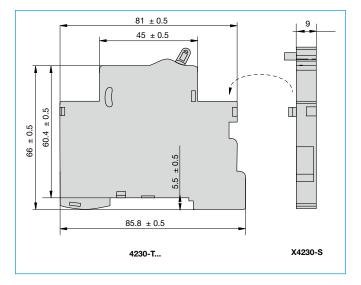

Add-on module for MCB type 4230-T. The fault indicator has a change-over contact as signal contact. There will only be a signal when the MCB tripped on grounds of a failure (overload, short circuit), but and not when the MCB was switched on or off manually. By actuating the reset lever on the front the tripping signal is acknowledged.

## **Typical applications**

Status monitoring of MCB and/or the connected loads.

### Mounting

The add-on module is mounted on the left side of the MCB (seen from the front). For mounting, the MCB has to be in the OFF position.

### Order numbering code

ype No.				
4230 Add-on mo	dule for type	4230-T		
Module typ	be			
A Faul	It indicator m	odule		
Style				
0 char	nge-over con	tact		
tern	ninals			
1 sc	rew terminals	;		
	Key for nom	inal output	t	
	A (to IEC/EN			
	AC voltag		,	
	Bated	Rated	Rated	Rated
	voltage	current	voltage	current
	240 V	6 A	24 V	6 A
	277 V	3 A	48 V	2 A
			130 V	1 A
	B (to UL 48	9)		
	12240 V	,	1224 V	6 A
	415 V	3 A	48 V	3 A
			130 V	1.5 A
	Delivery	condition		
				mounted by the user
		piloa sopur		incancea by the door
4230-A 0 1	A L orde	ering examp	ole	

**Technical Data** 

#### Rated currents to IEC/EN 60947-5-1:

Voltage ratings:	AC 240 V	AC 415 V	DC 24 V	DC 48 V	DC 130 V
Current ratings:	6 A	3 A	6 A	2 A	1 A

#### Rated currents to UL 489:

Voltage ratings:	AC 12 240 V	AC 277 V	DC 12 24 V	DC 48 V	DC 110 220 V
Current ratings:	6 A	3 A	6 A	3 A	1.5 A

Typical life	20,000 cycles
Tightening torque	1 Nm max.
Ambient temperature	-35 °C+ 70 °C
Width	9 mm
Mass	approx. 29 g

Approvals		
Approval authority	Standard	Types
UL	UL 489	with key index "B"

### **Mounting instructions**


#### Mounting to MCB to UL 489

The following steps have to be carried out for mounting the fault indicator module:

- Remove the left-side covers for the latching notches of the fault indicator module on both isolation pieces of the MCB, e.g. by means of a screw driver
- Pull off the isolation pieces from the MCB to the front
- Remove blanking plug on MCB to open left-side holes for latching notches of indicator switch
- Re-insert isolation pieces onto MCB
- Pull off left-side adhesive cover and carefully remove the perforated cover below


Caution: the MCB to UL489 must only be operated with the insulation pieces fitted.

### Schematic diagrams



Note: As soon as the fault indicator module is mounted on the MCB, the terminals 912 and 92 are connected when the MCB is in ON condition; ther terminals 91 and 94 are connected when the MCB tripped electrically; the terminals 91 and 92 are connected when the MCB was tripped manually; at the same time the terminals 91 and 94 do not have contact.

## **Mounting principle**

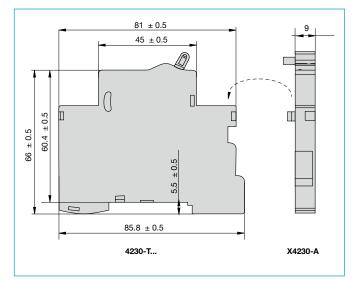

f

Add-on module for MCB type 4230-T. The working current module serves for remote trip of the MCB and for signalling whether the MCB was tripped electrically or manually.

### **Typical applications**

Electrical remote trip of safety equipment with simultaneous monitoring of MCB status or its connected load.


### Mounting

The add-on module is mounted on the left side of the MCB (seen from the front). For mounting, the MCB has to be in the OFF position. When auxiliary contact module/fault indicator module and a working current module are mounted at the same time, the working current module always has to be mounted first.

#### Order numbering code

Add-on module	101 type 4230-1		
Module type F Working cur			
	rent module		
Style			,
•	coil and auxiliar		angeover)
	isolated from th	ne MCB	
terminals	-		
1 screw t			
	rovals		
	thout		
	02 100		
	Delivery condit		a ta ba mayustad
			s to be mounted
	by the user		Approval
	Rated volta	A	B
	AC 120 V	A	UI 489
	AC 120 V AC 240 V		UL 489
	AC 240 V AC 277 V		UL 489
	AC 217 V AC 415 V		02 403
	DC 12 V		 UL 489
	DC 12 V DC 24 V	without	UL 489
	DC 24 V DC 48 V	without	UL 489
	DC 48 V DC 125 V		UL 489
	DO 125 V		02 409

### **Mounting principle**

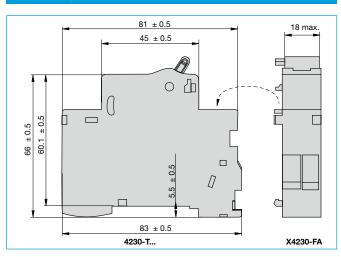

-		
	hnical	Data
	moa	Data

Voltage ratings AC	AC 415 V	AC 277 V	AC 240 V	AC 120 V
Min. trip voltage	AC 200 V	AC 160 V	AC 160 V	AC 80 V
Power consumption	240 W	240 W	200 W	200 W
min. response power	35 W	35 W	35 W	35 W
Rated current of auxiliary contact	3 A	3 A	6 A	6 A
Voltage ratings DC	DC 125 V	DC 48 V	DC 24 V	DC 12 V
Min. trip voltage	DC 80 V	DC 24 V	DC 16 V	DC 8 V
Power consumption	200 W	200 W	200 W	200 W
min. response power	30 VA	30 VA	30 VA	30 VA
Rated current of auxiliary contact	1.5 A	2 A	6 A	6 A
Trip time	< 10	ms		
Typical life	20,00	0 cycles		
Tightening torque	1 Nm	max.		
Ambient temperature	-35 °(	C+ 70 °C		
Width	18 mi	m		
Mass	appro	ox. 60 g		

### **Mounting instructions**

Mounting to MCB to UL 489


The following steps have to be carried out for mounting the auxiliary contact module:

- Remove the left-side covers for the latching notches of the working current module on both isolation pieces of the MCB, e.g. by means of a screw driver
- Pull off the isolation pieces from the MCB to the front
- Remove blanking plug on MCB to open left-side holes for latching notches of working current module
- Re-insert isolation pieces onto MCB
- Pull off left-side adhesive cover and carefully remove the perforated cover below

Caution: the MCB to UL489 must only be operated with the insulation pieces fitted.

Approvals		
Approval authority	Standard	Types
UL	UL 489	Approval type "B" according to ordering number code

### Schematic diagrams

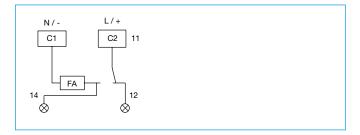

## Busbars UL 489 to be cut to length

Busbars for the connection of circuit breakers **type 4230-..U.** to **UL 489** The busbars of 1m length can individually be cut to a suitable length for the application and isolated with end caps. Depending on the control cabinet design, the supply is by means of supply terminals without increasing the installation width or by means of a terminal block directly on the rail without increasing the installation height.

The models marked with "HS" are suitable for use with auxiliary contact modules with a width of 9 mm.


Busbar cross section: Max. busbar current I<sub>S</sub> (at 35°C): with supply at the end: with supply in the middle: Short circuit strength I<sub>CC</sub>: Max. operating voltage: Degree of protection: Step size: 18 mm<sup>2</sup>. 80 A 160 A 10 kA 480 V AC/DC IP20 17.8 mm



supply with terminal block

Number of poles	Number of modules	part no.
1-pole	57	X4230-BU157P18S
2-pole	56	X4230-BU256P18S
3-pole	57	X4230-BU357P18S
1-pole + HS	37	X4230-BU137P18H2S
2-pole + HS	46	X4230-BU246P18H1S
3-pole + HS	48	X4230-BU348P18H1S

HS = application with auxiliary switch 9 mm

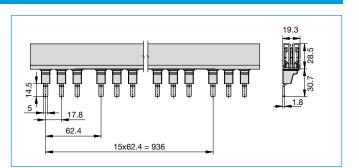


#### Accessories for busbars UL489 that can be cut to length:

#### Supply terminal

X4230-FTUC35 Cross-section: Stripping length: Tightening torque: Ampacity:

2.5-35 mm² (2–14 AWG) ~ 14 mm 5.5 Nm (50 lbf.in) max. 115 A

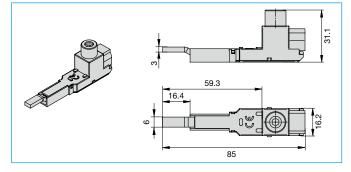


#### Terminal block part no. X4230-FBU50

Cross-section:

Stripping length: Tightening torque: 1.5–50 mm<sup>2</sup> (1–14 AWG), solid/stranded 1.5-35 mm<sup>2</sup> (2–14 AWG), finely stranded with wire end ferrule ~ 15 mm supply: 3.5 Nm (35 lbf.in) output (track side): 2.5 Nm (22 lbf.in) max. 115 A

Ampacity:

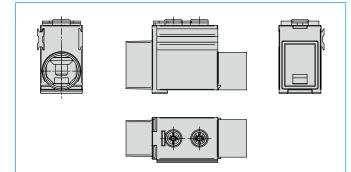

#### end caps part no. X4230-EC1

Accessories for all busbars UL489 that can be cut to length:

Protection against brush contact part no. X4230-TC2

for covering unused modules

## Busbars UL 489, cannot be cut to length

Busbars for the connection of circuit breakers type 4230-..U.. to UL489. Depending on busbar type suitable for up to 18 poles.

16 mm<sup>2</sup> 115 A 10 kA 480 V AC/DC IP20 17.6 mm


Accessories for busbars UL489 that cannot be cut to length:

**Terminal block** part no. X4230-FBU50

Cross-section

Stripping length: Tightening torque: 1.5-50 mm<sup>2</sup> (1-14 AWG), solid/stranded 1.5-35 mm<sup>2</sup> (2-14 AWG), finely stranded with wire end ferrule ~ 15 mm supply: 3.5 Nm (35 lbf.in)

Number of poles	Number of modules	part no.
1-pole	6	X4230-BU106P16A
1-pole	12	X4230-BU112P16A
1-pole	18	X4230-BU118P16A
2-pole	6	X4230-BU206P16A
2-pole	12	X4230-BU212P16A
2-pole	18	X4230-BU218P16A
3-pole	6	X4230-BU306P16A
3-pole	12	X4230-BU312P16A
3-pole	18	X4230-BU318P16A

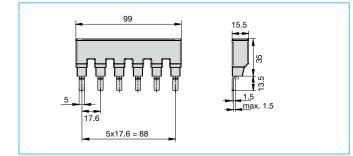



#### Accessories for busbars UL489 that cannot be cut to length:

### supply terminal part no. X4230-FTU35


Cross-section: Stripping length: Tightening torque: Ampacity:

2.5-35 mm<sup>2</sup> (2-14 AWG) ~ 14 mm 5.5 Nm (50 lbf.in) max. 115 A

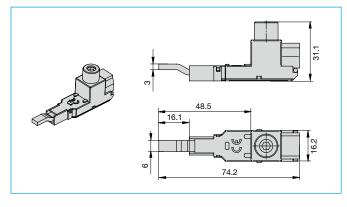

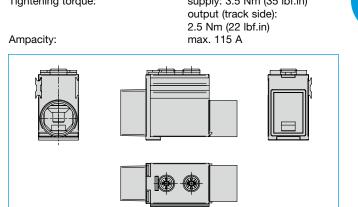

Protection against brush contact part no. X4230-TC1

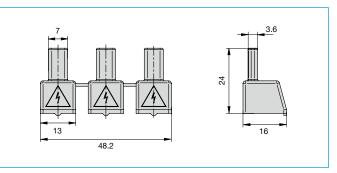

## Approvals

Approval authority	Standard	Types
UL	UL 489	X4230-BU
UL	UL 508	X4230-BR

### Busbars UL 508 to be cut to length

Busbars for the connection of circuit breakers type 4230-..E.. To UL 1077 The busbars of 1m length can individually be cut to a suitable length for the application and isolated with end caps.


Depending on the control cabinet design, the supply is by means of supply terminals without increasing the installation width or by means of a terminal block directly on the rail without increasing the installation height.

The models marked with "HS" are suitable for use with auxiliary contact modules with a width of 9mm.

Busbar cross section:	18 mm².
Max. busbar current I <sub>s</sub> (at 35°C):	
with supply at the end:	80 A
with supply in the middle:	160 A
Short circuit strength I <sub>cc</sub> :	10 kA
Max. operating voltage:	480 V AC/DC
Degree of protection:	IP20
Step size:	17.8 mm

Number of poles	Number of modules	part no.
1-pole	57	X4230-BR157P18SB
2-pole	56	X4230-BR256P18SL
3-pole	57	X4230-BR357P18SL
1-pole + HS	37	X4230-BR137P18H1SB
2-pole + HS	46	X4230-BR246P18H1SL
3-pole + HS	48	X4230-BR348P18H1SL

HS = application with auxiliary switch 9 mm

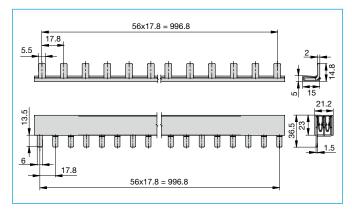


end caps for single pole busbars: for multipole busbars:

part no. X4230-EC2 part no. X4230-EC3

Protection against brush contact part no. X4230-TC3

for covering unused modules.

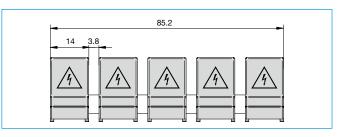


Accessories for busbars UL508 that can be cut to length:


supply terminals for single pole busbars: for multipole busbars:

Cross-section:

Stripping length: Tightening torque: Ampacity:



6 - 50 mm<sup>2</sup> (1-10 AWG), solid/stranded 6 - 35 mm<sup>2</sup> (2-10 AWG), finely stranded with wire end ferrule ~ 14 mm 5.5 Nm (50 lbf.in) max. 115 A

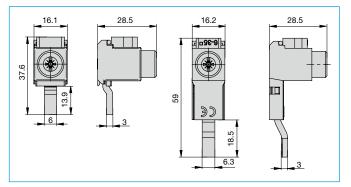

#### Accessories for busbars UL508 that can be cut to length:

#### **Terminal block** part no. X4230-FBR50


Cross-section:

Stripping length:


Tightening torque:


6 - 50 mm<sup>2</sup> (1-10 AWG), solid/stranded 6 - 35 mm<sup>2</sup> (2-10 AWG), finely stranded with wire end ferrule ~ 15 mm supply: 3.5 Nm (35 lbf.in) output (track side): 2.5 Nm (22 lbf.in) max. 115 A

Ampacity:









### Busbars for IEC applications, to be cut to length

Busbars for the connection of circuit breakers type 4230-..E.. to IEC 60947-2. The busbars of 1m length can individually be cut to a suitable length for the application and isolated with end caps.


The models marked with "HS" are suitable for use with auxiliary contact modules with a width of 9 mm.

Busbar cross section: Max. busbar current Is (at 35°C): with supply at the end: with supply in the middle: Short circuit strength Icc: Max. operating voltage: Degree of protection: Step size:

16 mm<sup>2</sup> 80 A 130 A 10 kA 690 V AC/DC IP20 17.8 mm

Number of poles	Number of modules	part no.
1-pole	57	Y 311 622 01
2-pole	56	Y 311 623 01
3-pole	57	Y 311 624 01
4-pole	56	Y 311 625 01
1-pole + HS	37	Y 311 626 01
2-pole + HS	46	Y 311 627 01
3-pole + HS	48	Y 311 628 01
4-pole + HS	52	Y 311 629 01


HS = application with auxiliary switch 9 mm

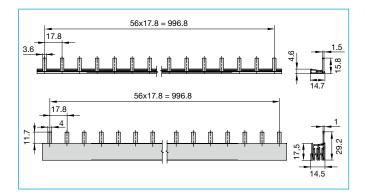

end caps for single pole busbars: for 2-/3-pole busbars for four-pole busbars:

part no. Y 307 851 01 part no. Y 308 506 01 part no. Y 311 633 01

Protection against brush contact part no. Y 311 632 01

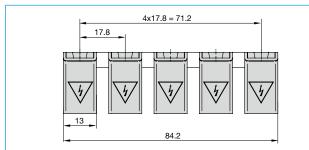


Accessories for busbars to IEC 60947 that can be cut to length:

supply terminal for multipole busbars: part number Y31163001

Cross-section

solid/stranded 4-16 mm<sup>2</sup>, finely stranded with wire end ferrule ~ 11 mm max. 80 A

Stripping length: Ampacity:

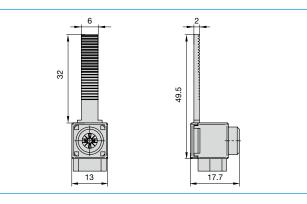

Accessories for busbars to IEC 60947 that can be cut to length:

6-50 mm<sup>2</sup>.

4-35 mm<sup>2</sup>,

end ferrule

max. 125 A

~ 14 mm

solid/stranded

1 Nm (at 6 mm<sup>2</sup>)

3.5 Nm (at 50 mm<sup>2</sup>)

IP20, isolated bottom


finely stranded with wire


supply terminal for multipole busbars: part no. Y 311 631 01

Cross-section:

Stripping length: Tightening torque:

Ampacity: Degree of protection:





6-25 mm<sup>2</sup>,

1